




AIR COOLED HEAT EXCHANGER

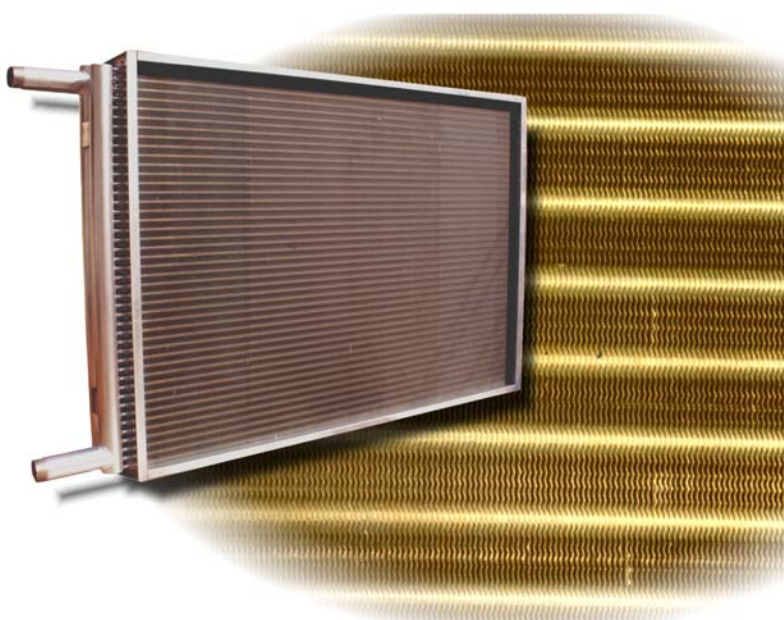


UNIT APPLICATION :

*HVAC Cooler
Oil Coolers
Fluid Coolers
After Coolers
Cooling Coils*

*Evaporators
Gas Coolers
Air Heaters
Condensers
Heating Coils*

*Chillers
Charge Air Coolers
Inter Coolers
Air Coolers
Dehumidifiers*

Cross Finned Coil Specification :

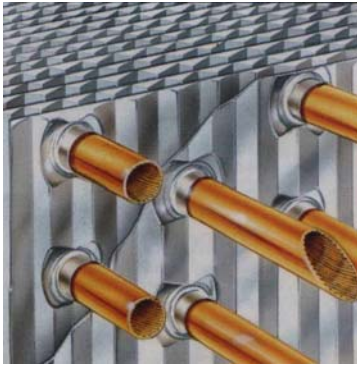

Tube Dia mm	Fin Spacing mm	Tube Pitch - mm	
		Horizontal	Vertical
9.5	2.2 ~ 4	22	25
12.7	1.5 ~ 8	27.5	31.75
		25	50
15.87	2 ~ 8	33	38
		50	50
Fin Thickness : 0.15 ~ 0.4 mm		Tube Thickness : 0.3 ~ 1.2 mm	
Fin Material : Alum ; Cu ; Cu/Ni ; SUS 304 or Aluminium Coating		Tube Material : Cu ; Cu/Ni ; SUS 304	



Heating Coil (Hot Water to Air)



Cooling Coil (Water to Compress Air)



HVAC Cooling / Heating Coil



Heating Coil with Tube Sheet



PT. METALINDO E. ENGINEERING

HEAT TRANSFER ENGINEERING

Jl. KH. Zaenal Mustafa No. 17 - Jatinegara
 Jakarta Timur 13350
 Phone : 62 21 856 1234 (Hunting)
 Fax : 62 21 8513109
 Web site : www.metalindoengineering.com
 Email : info@metalindoengineering.com